

Lightning/surge arresters CombiController V 25-B+C, V 25-B+C/...+NPE



Operation and fields of application

Lightning and surge arrester V 25-B+C ensures lightning protection potential equalisation in accordance with VDE 0185, Part 1 and Part 100. The device is an arrester of requirement Class B+C to DIN VDE 0675, Part 6 (Draft 11.89) A1, A2. It ensures potential equalisation for the energy supply line in lightning protection installations for buildings. The arrester can also be used in buildings that are supplied with power via an overhead line, since direct or partial lightning currents may be expected there as well.

Version V 25-B+C/3+NPE (requirement Class B+C) is a special surge arrester for TN-C-S, TN-S, TT and IT systems. This device was developed for the new requirements of DIN VDE 0100, Part 534/A1, to allow simple, safe installation of the devices.

High-performance arrester OBO V 25-B+C has a special varistor circuit made up of powerful zinc oxide varistors with a highly non-linear characteristic ($\alpha > 30$). This design ensures maximum protection

even with powerful surges. Even at a maximum load I_{max} of 50 kA the protection level is below 1.5 kV. This enables this type of device to withstand even partial lightning currents from direct lightning strikes. In the event of an overload, the built-in isolating device isolates the faulty arrester module from the network and indicates this with a red field.


Because of the low residual voltage, OBO lightning arrester V 25-B+C can also be used as a combined arrester B and C.

Service location in accordance with VDS 2031.


Mounting

The OBO V 25-B+C can easily be installed in any distribution box or switchgear cabinet by snap-fitting to any commercial 35 mm top-hat rail. The NPE arrester element type C 25-B+C/NPE and the matching base are designed so that they cannot be plugged in the wrong way round (coding). This ensures correct installation of the upper parts of the arresters.

Test marks



Other marks



Ordering data

Type	Description	Order no.
V 25-B+C/1	1-pole, complete ¹⁾ ; 280 V	5097 04 5
V 25-B+C/2	2-pole, complete ¹⁾ ; 280 V	5097 01 0
V 25-B+C/3	3-pole, complete ¹⁾ ; 280 V TN-C	5097 00 2
V 25-B+C/4	4-pole, complete ¹⁾ ; 280 V TN-S	5097 03 7
V 25-B+C/3+NPE	3+1-pole, complete ¹⁾ 280 V TT + IT	5097 40 1
V 25-B+C/2-385	2-pole, complete ¹⁾ ; 385 V	5097 09 6
V 25-B+C/4-385	4-pole, complete ¹⁾ ; 385 V	5097 10 0
V 25-B+C/3+NPE-385	3+1-pole, complete ¹⁾ 385 V TT + IT	5097 10 3
V 25-B+C/0-150	Upper part; 150 V version	5097 08 8
V 25-B+C/0-280	Upper part; 280 V version	5097 05 3
V 25-B+C/0-385	Upper part; 385 V version	5097 06 1
C 25-B+C/NPE	Upper part NPE spark gap	5095 60 3
V 25-B+C/4-G	4-pole V 25-B+C in insulating material housing (IP 65); 280 V	5097 25 8

¹⁾ Complete = upper part and base

The V 25-B+C/... is also available on request in a 150 V and a 385 V version.


Suitable bases for V 25-B+C, see page 35

Features at a glance V 25-B+C	Advantages in use
Simple installation via the marked terminals	▶ Arresters still work after frequent operation
Combined arresters B and C for compact applications	▶ One arrester in main distribution board is sufficient
Plug-in upper part	▶ A faulty arrester module can be changed with the mains voltage on
Pre-wired arrester blocks, 1-4-pole blocks	▶ Easy to install
Thermal isolating device with optical indication	▶ Permanent check of arrester serviceability
Arrester with NPE spark gap in one module	▶ Certainty in TN-S, TT and IT systems that no voltage can reach the protective earth (PE) conductor
C 25-B+C/NPE with protection against reversed insertion (coding)	▶ Simple, professional installation of the arrester modules


Combicontroller lightning arrester		V25-B+C
Description		320 V
Maximum continuous operating voltage (max. permitted operating voltage)	Uc AC Uc DC	320 V 410 V
LPZ		0 → 2
Requirement class to DIN VDE 0675, Part 6 (Draft 11.89) A1, A2 to IEC 61643-1,		B+C Class I – Class II
Tested to		IEC 61643-1, prEN 61643-1, E DIN VDE 0675-6:1989-11 and Part 6/A1
Test currents to DIN VDE 0675, Part 6, A1+A2		30 kA
Nominal discharge current	In(8/20)	
Max. Discharge current per block	I _{max} (8/20)	
	CombiController V25-B+C/1...	50 kA
	CombiController V25-B+C/2...	100 kA
	CombiController V25-B+C/3...	150 kA
	CombiController V25-B+C/4...	200 kA
Maximum discharge current (8/80) in accordance with VdS 2031 for CombiController V25-B+C/4..		I _{max} 100 kA
Surge voltage test (10/350) with the lightning current parameters set out in IEC61312-1(02.95)		
Impulse current	I _{imp}	7kA
Charge	Q	3.5As
Specific energy	W/R	12 kJ/Ω
Voltage protection level at 1 kA (8/20)	Up	≤790V
at 5 kA (8/20)	Up	≤900V
at In	Up	≤1140V
Response time	tA	<25 ns
Short-circuit withstand strength 25 kA with max. upstream fuse		160 A gI/gG
Connection cross-section		2.5-25mm ² (fine-stranded with core end sleeves) 2.5-35mm ² (single and multi-stranded ¹)
Mounting on		35 mm top-hat rail to EN50022
IP Code		IP 20
Temperature range		-40°C to +80°C

Spark gap CombiController NPE		C25-B+C/NPE
Maximum continuous operating voltage	Uc	255V/50-60 Hz
Insulation resistance at 100V		R _{ins} >10 GΩ
Surge voltage test (10/350) with the lightning current parameters set out in IEC 61312-1(02.95)		
Impulse current	I _{imp}	25kA
Charge	Q	12.5 As
Specific energy	W/R	160 kJ/Ω
Nominal discharge current	In(8/20)	50 kA
Voltage protection level	Up	≤1.2kV
Response time	tA	≤100ns
Follow current at Uc	I _f	100 Arms
Temperature range	v	-40°C to +80°C


Article	Part no.
V25B+C/0 - 320 V	5097 29 0
C25B+C/0 - NPE	5095 60 3
V25B+C/3+NPE-FS 320 V	5097 29 6
V25B+C/1+NPE-FS 320 V	5097 09 1

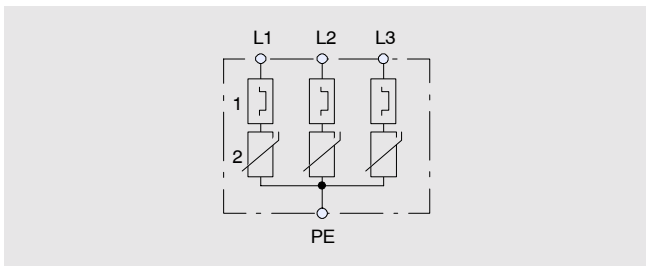


Block diagram of V 25-B+C/3

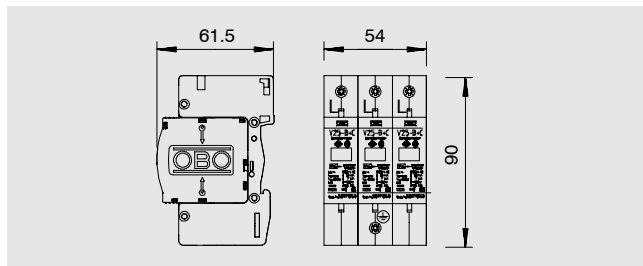


Dimension drawing

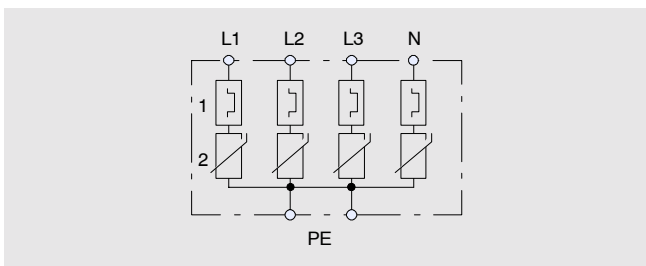


Block diagram of V 25-B+C/4

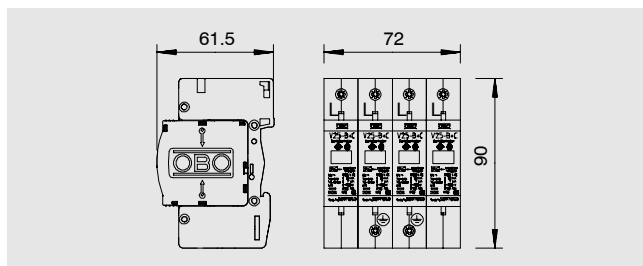


Dimension drawing

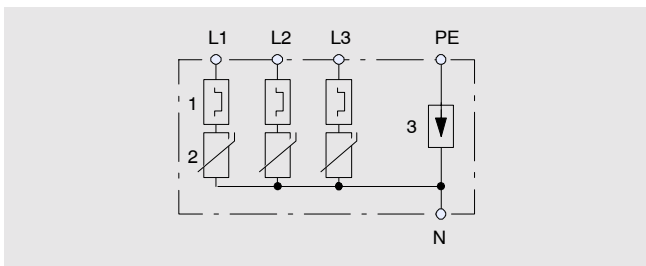


Block diagram of V 25-B+C/3+NPE

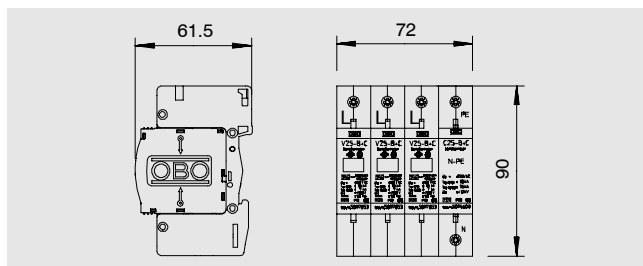

Dimension drawing

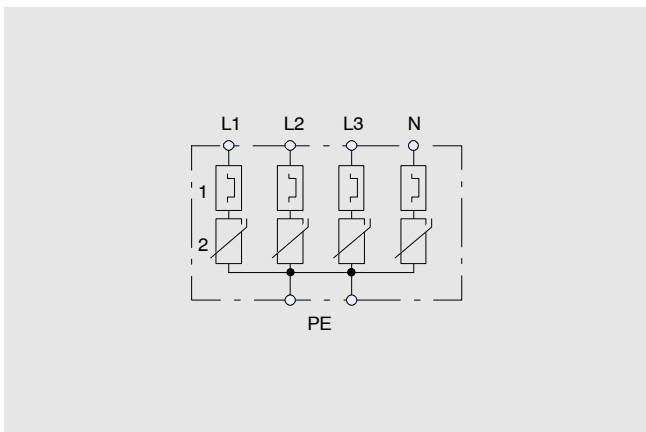

Block diagram of V25-B+C/4-G

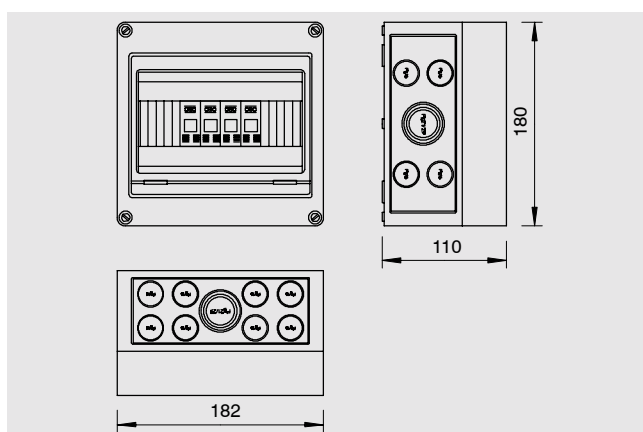

Dimension drawing

Key

- 1) Thermal isolating device
- 2) Metal-oxide varistor
- 3) NPE sum current spark gap